

BizNGO Annual Meeting – 12/6/2022

# Connecticut's Program to Evaluate AFFF Alternatives & Equipment Decontamination Options

Speaker: Shannon Pociu, CT DEEP Remediation Division



AFFF spill to the Farmington River, Windsor, CT, June 9, 2019

# CT AFFF Take-Back Program Background

- ❑ Planning for an AFFF Take-Back Program began in 2019 prior to the State's [PFAS Action Plan](#)
- ❑ June 2019 - [Advisory Bulletin](#) issued on AFFF use
- ❑ 2020 - Bond funding received for Take-Back Program and private well testing for PFAS
- ❑ July 13, 2021 – [Public Act 21-191 signed, AAC the Use of PFAS in Firefighting Foam](#)
  - Banned training with AFFF upon passage
  - Banned most AFFF uses as of 10/1/21
  - Directed DEEP to initiate an AFFF Take-Back Program (began in April 2021)



# CT Next Generation Foam Committee

Convened March 2019 by the CT Dept. of Emergency Services & Public Protection's Commission on Fire Prevention & Control

- **Objective: Identify a fluorine-free, environmentally friendly replacement for AFFF used in CT's regional foam trailers**
- **Members**
  - CT DESPP, State Fire Administrator
  - CT DEEP, Emergency Response Unit and Remediation Division
  - CT Municipal Fire Department leaders
  - Petroleum Terminal representative
  - Expanded to include representatives of MassDEP, RI DEM, and ME DEP who wished to observe



# Fluorine-Free Foam (F3) Evaluation

## ❑ Replacement Foam Requirements for Fire Services:

- ✓ Effective on both polar and nonpolar flammable liquids
- ✓ Meet **NFPA 11** – Standard for Low-, Medium-, and High-Expansion Foams
- ✓ Meet **UL-162** GFGV – Foam Equipment & Liquid Conc.
- ✓ Foam trailer equipment compatibility (aeration nozzles)

## ❑ Requirements for Environmental Protection

- ✓ **Favorable laboratory report = Fluorine-free + No regrettable substitutions**
- Invited vendors of several “fluorine-free” firefighting products
- Reviewed GreenScreen™ (2018) list of certified foams
- Consulted with LASTFire representative



# Laboratory Parameters Tested

- Products tested were purchased by CT DEEP and analyzed by MassDEP at Alpha Analytical and subcontracted labs (Harvard Univ. and Sterling Analytical).

Analysis	Method	Lab
PFAS	EPA 537 modified using isotope dilution (24 compounds)	Alpha Analytical
PFAS	TOP Assay (18 compounds)	Alpha Analytical
SVOCs	EPA 8270D (limited analysis)	Alpha Analytical
Inorganic Halides	Ion Chromatography (F/Cl/Br)	Harvard Univ.
Total Halogens	Combustion Ion Chromatography (F/Cl/Br)	Harvard Univ.
*Total Organic Halogens or	EPA 9076	Sterling Analytical
*Extractable Organic Halides	EPA 9023	Sterling Analytical



	Alpha Labs	Alpha Labs	Alpha Labs	Alpha Labs	Harvard U.	Harvard U.	Sterling Analytical
	PFAS by Isotope Dilution	Total Oxidizable Precursor (TOP) Assay (Pre-Treatment)	TOP Assay (Post-Treatment)	Semivolatile Organics by GC/MS (EPA 8270)	Inorganic halides by ion chromatography	Total halogens by Combustion ion chromatography	Total organic halogens/ extractable halides (DL: 50 ppm)
<b>Universal Green AR</b>	Non-detect	Non-detect	Non-detect	Non-detect	Non-detect	Non-detect	Non-detect (NOTE: SW-846 Method 9076, Total organic halogens)
<b>PhosChek Fluorine Free</b>	Non-detect	Non-detect	Non-detect	Non-detect	Non-detect	Cl	Non-detect (NOTE: SW-846 Method 9076, Total organic halogens)
<b>NovaCool</b>	PFHxDA (J)	Non-detect	PFBA PFPeA (J) PFHxA (J)	Not analyzed	Fl, Cl	Non-detect (Cl not quantified)**	Non-detect (NOTE: SW-846 Method 9076, Total organic halogens)
<b>Knockdown (wetting agent)</b>	PFHxA (J)* - det in field blank	PFHxA (J)* - det in method blank	PFBA (J)* - det in method blank PFHxA (J)* - det in method blank PFHpA (J)	Not analyzed	Cl**	Non-detect	Non-detect (NOTE: SW-846 Method 9023, Extractable organic halides)
<b>F-500 (wetting agent)</b>	PFHxA (J)* - det in field and method blank	PFHxA (J)*	PFBA (J)* - det in method blank PFPeA (J) PFHxA (J)* - det in field/ method blank PFHpA (J)	Not analyzed	Non-detect	Non-detect	Non-detect (NOTE: SW-846 Method 9023, Extractable organic halides)
<b>Final Clean X1</b>	DEPA, DEPeA, 4:2 ETS	DEPA, 6:2 ETS	Non-detect*** Reporting	Non-detect	Cl**	Fl, Cl	Non-detect



# Take-Aways from F3 Testing/Evaluation

- ❑ F3 products considered were not suitable for LASTs with subsurface injection fire suppression systems
- ❑ Foam concentrate is a tough matrix to analyze!
  - Dilution needed → Detection limits on order of ppm or ppb vs. drinking water advisory levels in ppt
- ❑ Defer to GreenScreen Certified™ for Firefighting Foam
- ❑ CT Fire Services Next Generation Foam Committee identified an F3 product for use in state apparatus – National Foam Universal®F3 Green

# AFFF Take-Back Program


## ✓ Phase 1 – Container Collection & Disposal of AFFF concentrate from state/municipal fire departments

- April 2021 – March 2022
- **35,300 gal.+ collected from >250 town fire departments**
- **Cost of approx. \$900,000** for pick up and safe disposal of AFFF in containers

## ✓ Phase 2 – PFAS Decontamination Study/ Regional Foam Trailer Cleaning:

- Summer 2021-2022
- Now purchasing new foam trailers

## □ Phase 3 – Dispose of AFFF from ~400 municipal fire trucks: Pending funding

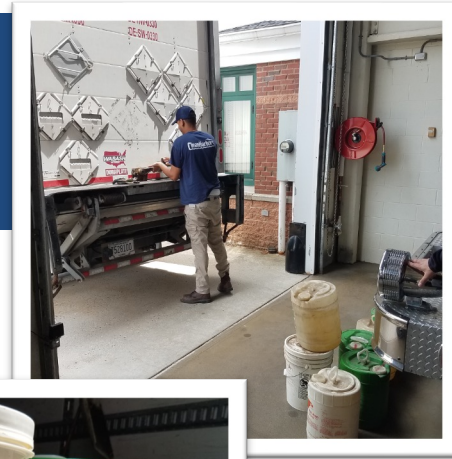




# Decon Demonstration Project Goals

- ❑ Risk reduction rather than elimination
  - Gross PFAS removal
  - How to clean?
  - Clean to what level? ppb? ppt?
- ❑ Waste minimization
- ❑ Cost-benefit analysis
  - Clean vs. replace equipment?
  - On-site treatment of waste liquids vs. off-site disposal?
- ❑ Refine SOP for remaining trailers and tailor approach for cleaning municipal fire apparatus



# Demonstration Project Approach

- ❑ 2 vendors using 2 different cleaning solutions at separate locations
  - **AECOM** teaming with TRS and Hiller using **PerfluorAd**® system
  - **Arcadis** using V171 / Fluoro Fighter™

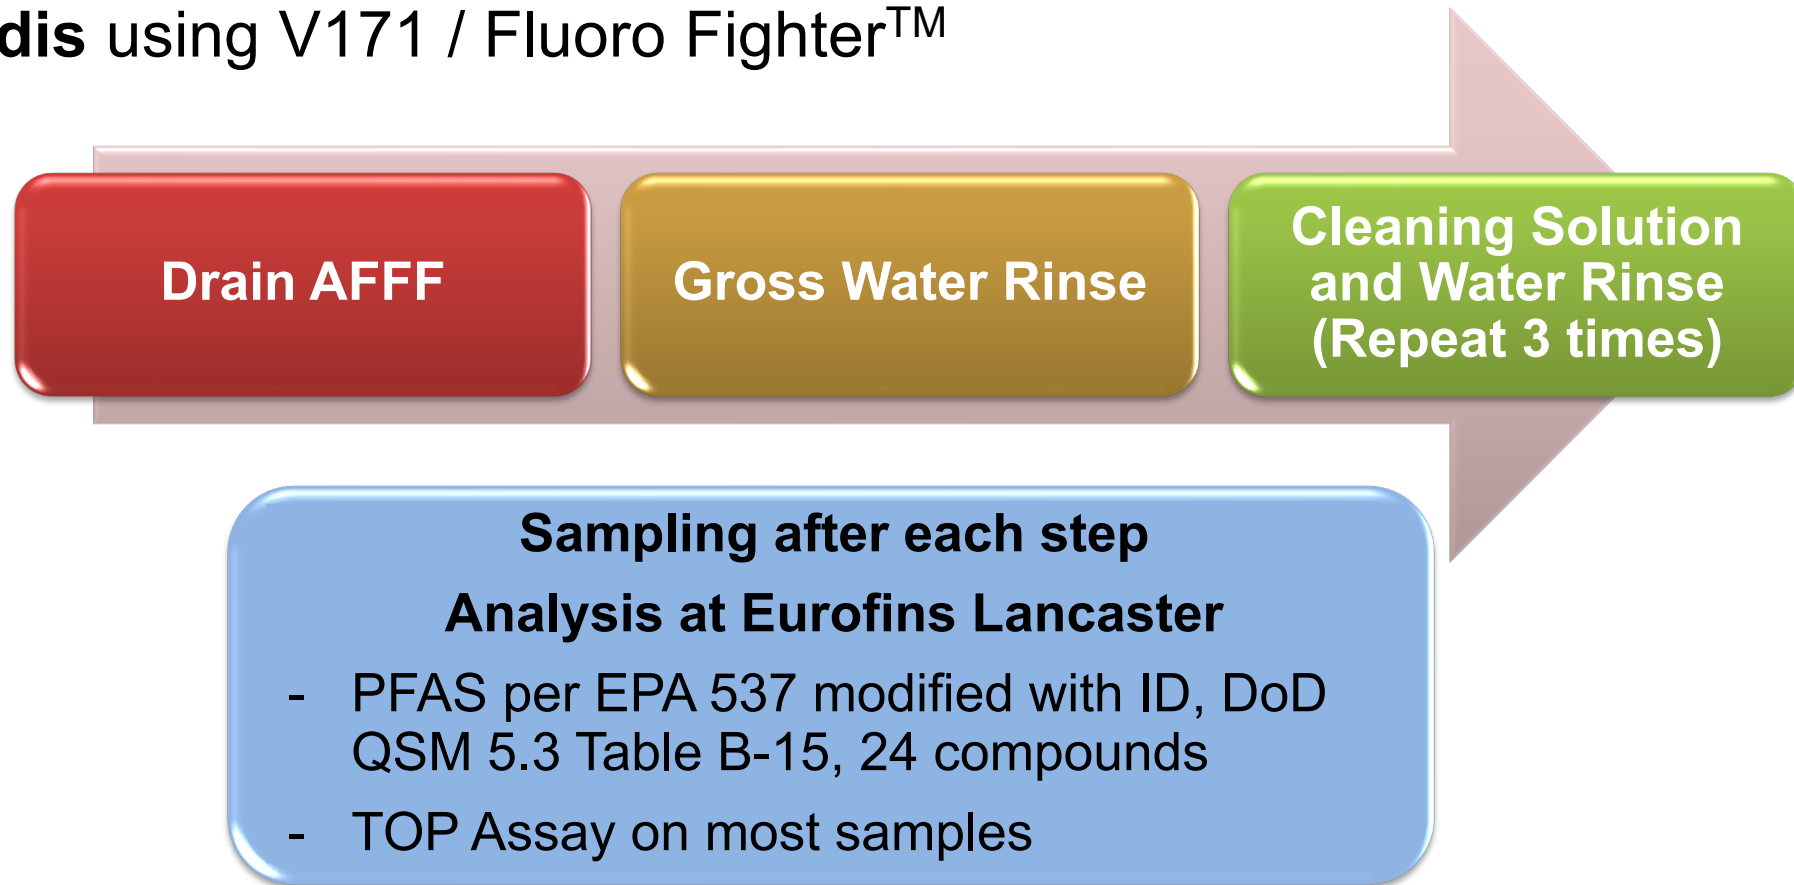


# Foam Trailer & Fire Truck Cleaning




# Results of Trailer Cleaning

## Fluoro Fighter™ Cleaning PFAS Reduction

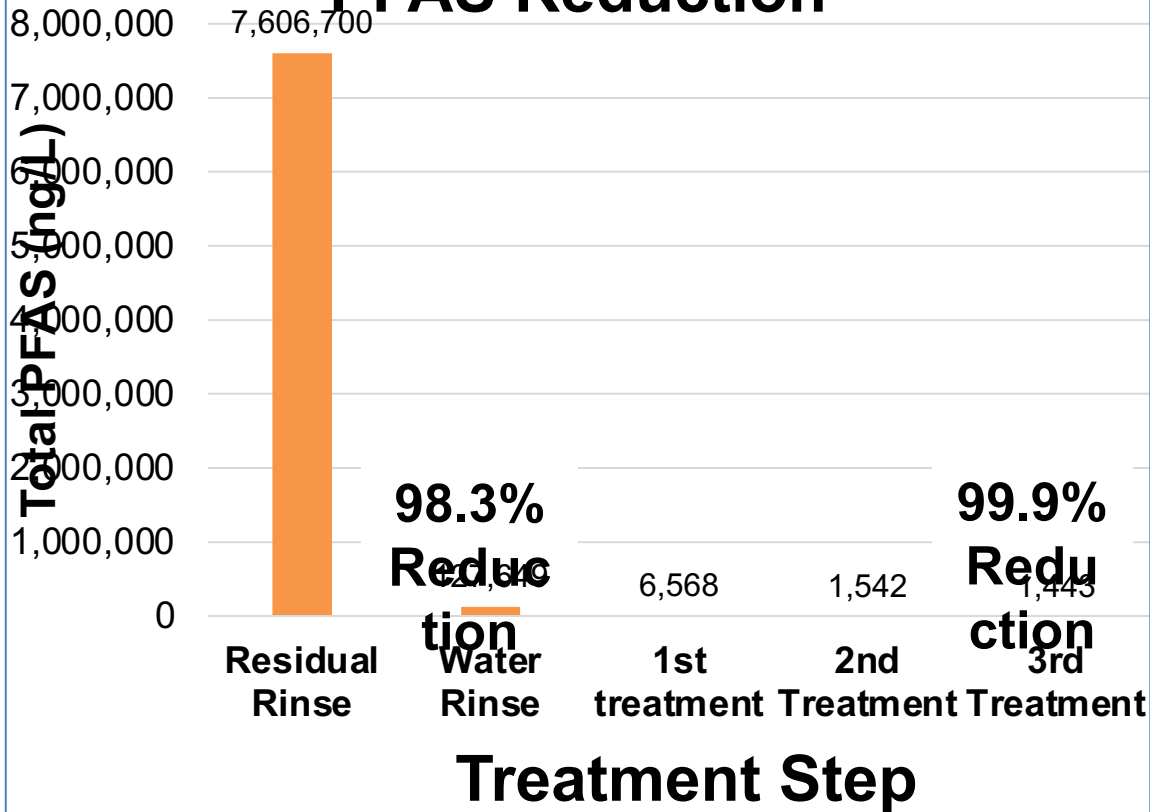

## PerfluorAd® Cleaning PFAS Reduction

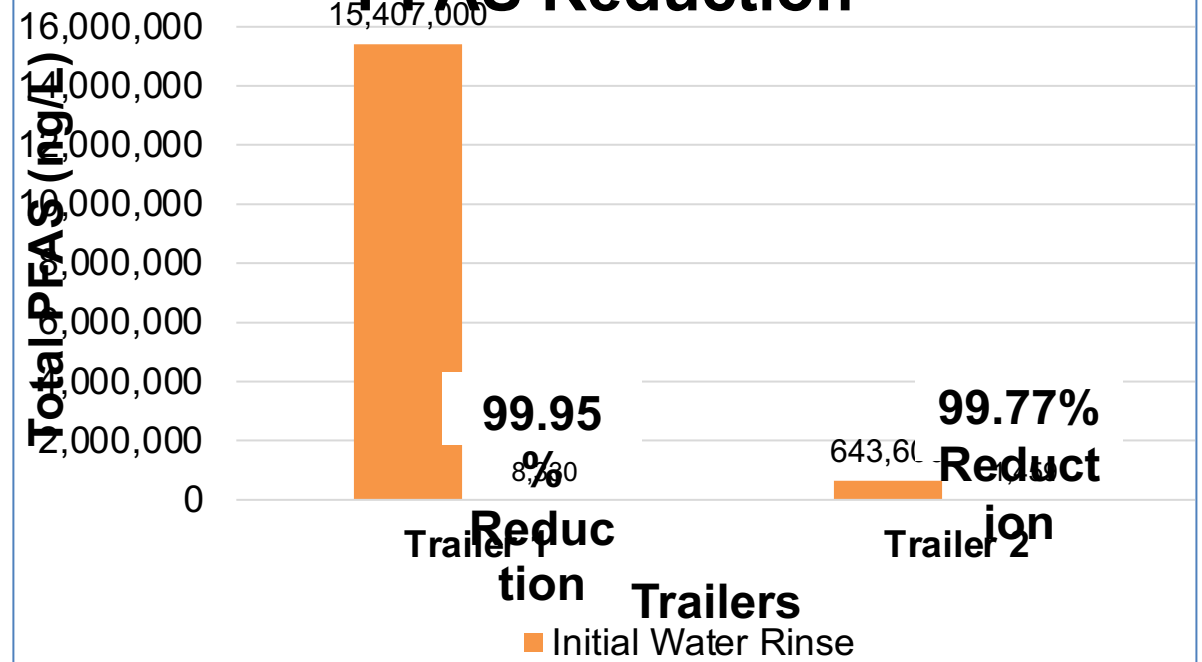

Both cleaning agents had similar performance, but residual PFAS remained in the apparatus, even after 3 treatments.



# Key Take-Aways from Decon Demonstration

- ❑ **Proprietary cleaning agents were more effective** at reducing PFAS than plain water rinses (>99% vs. ~95% removal)
- ❑ However, **residual PFAS levels remain** following use of proprietary cleaning agents that will still cross-contaminate new Fluorine-Free Foam (F3)
- ❑ **Significant Logistics and Cost**
  - Fire apparatus are custom. Not a “one-size-fits-all” approach. Is the replacement foam compatible with existing equipment?
  - Look for economies of scale. More cost effective to clean multiple apparatus at the same time.
- ❑ **Disposal of AFFF and PFAS waste** can be challenging and expensive.

# Risk Reduction

**Transitioning to Fluorine-Free Foam and cleaning fire apparatus is collectively a significant environmental improvement over continued use of AFFF.**

- However, residual PFAS remaining in fire apparatus, even after rinsing, can cross-contaminate the new foam. Deployment of the new foam may still pose a potential environmental and/or human health risk.



[This Photo](#) by Unknown Author is licensed under [CC BY-SA](#)

# Next Steps...

## **Initiate purchase of new foam trailers**

- Cost-Benefit Analysis showed price of cleaning was equivalent to purchasing new trailers
- Will avoid cross-contamination of new foam

## **Continued Education & Outreach to Fire Services**

- Most AFFF use is illegal in Connecticut.
- Promote updated Guidance to Municipal Fire Departments that provides advice for using new foam and existing apparatus

## **Seek additional funding** to assist Municipal Fire Departments with disposal of AFFF in firetrucks and transitioning to F3.



# For more information

[CT DEEP PFAS Webpage](#)  
[PFAS Task Force Webpage](#)  
[CT PFAS Action Plan](#)

## Contact Information:

[Shannon.Pociu@ct.gov](mailto:Shannon.Pociu@ct.gov)

CT DEEP

Remediation Division

860-424-3546